



# Locating and Offering Optimal Price Distributed Generation Resources to Increase Profit Using Ant Lion Optimization Algorithm

Ebadollah Amouzad Mahdiraji<sup>1\*</sup>, Seyed Mohammad Shariatmadar<sup>2</sup>

<sup>1</sup>Department of Engineering, Sari Branch, Islamic Azad University, Sari, Iran, Email: Ebad.Amouzad@gmail.com

<sup>2</sup>Electrical Engineering Department, Naragh Branch, Islamic Azad University, Naragh, Iran, Email: shariatmadar@iau-naragh.ac.ir

---

## Abstract

Distribution of distributed generation resources in distribution systems has several advantages, including reducing losses, improving voltage profiles, reducing pollution, and increasing system reliability. However, one of the most important points regarding the placement of these resources in distribution networks is economic issues and the return on investment and the increase in profits from the placement of these resources. On the other hand, due to the privatization of power systems, other distribution networks will not necessarily own the distributed generation resources. Therefore, despite choosing the location of scattered production resources by the owners of scattered production resources and pricing their production power, the selection of purchasing power from each of the scattered production units or the national electricity system is done by the distribution network operator. It will be for supply. Thus, owners of scattered production resources must choose the location and price of the production capacity of their resources in such a way that their profit is maximized and at the same time the amount of payment paid by the network operator is minimized. Therefore, in this paper, the issue of location and optimal pricing of distributed products is considered to increase the profit of the owner of scattered production resources provided that the distribution company pays the minimum payment cost and the method used to solve this problem is the ant-optimization algorithm. It is inspired by the ant's milk hunting mechanism and is a powerful optimization algorithm.

**Keywords:** Distributed Generation Resources, Ant Lion Optimization, Optimal Location, Optimal Pricing

Article history: Received 07-July-2020; Revised 14-July-2020; Accepted 03-September-2020.

© 2019 IAUCTB-IJSEE Science. All rights reserved

---

## 1. Introduction

In recent decades, the restructuring of the electricity industry, as well as the privatization of this industry, has been discussed and implemented in some countries. During this time, the electricity industry has undergone fundamental changes in terms of management and ownership due to increased efficiency and encouragement of investors, so that to create a competitive environment, its various sectors, including production, transfer, and distribution, are independent. Have been. Also, factors such as environmental pollution, problems with the construction of new transmission lines, and technological advances in economizing the construction of small-scale production units compared to large-scale production units, on the

other hand, increase the use of small production units called DG, mainly to distribution networks. Connected and do not require transmission lines [1-4]. DG has many benefits for the distribution system, including reducing losses, reducing peak load, reducing line density, providing ancillary services, improving power quality and reliability, reducing uninterruptible power supply, and delaying costs. Investment in network upgrades [5]. It provides different types of DGs to compensate for active and reactive power to reduce active losses in the secondary distribution system using the PSO algorithm [6]. The optimal power factor is intended to minimize power loss. The results obtained by PSO have been confirmed using an analytical approach. The analytical approach of each shin

evaluates the system for finding the optimal solution and is, therefore, suitable for finding the location and size of DG in a small system. In this paper, in addition to reducing line losses, the size of DGs is reduced and voltage constraints are observed. In [7], using the fireball algorithm, the optimal size and location of scattered production is determined. In this study, the objective function is to maximize profits. In the proposed method, DG generators are of two types, photovoltaic and CHP. CHP is modeled as a voltage control node and photovoltaic panels are modeled as generators distributed in constant power mode. The method presented in this paper is simulated in the MATLAB environment and on IEEE 37-bus system. The results show the high efficiency of the algorithm provided in solving this problem. In [8], it provided a way to ensure the dispersion of indestructible dispersed production units in the distribution system for economic recovery. The cost of installation and the operating cost of scattered production versus the amount of reliability is optimized as "willingness to pay" to customers to prevent power outages. Therefore, it can be said that the main purpose of this article is to determine the optimal combination between scattered production units for installation. In this study, the genetic algorithm was used for optimization and the system studied was the IEEE 33-bus system. A framework for integrating geographic information systems (GIS) and mathematical optimization to obtain the optimal location and size of the PV unit for the next two decades has been proposed. A GIS module has been developed to find suitable roofs and panel capacity according to the amount of solar radiation, slope, and height. Then, an optimization module was used to maximize the long-term net profit of PV facilities due to different investment costs, inverter replacement, and maintenance operations [9]. In this paper, the problem of locating and optimizing the optimal distribution of scattered products to increase the profit of the owner of scattered products will be solved provided that the distribution company pays the minimum cost and the method used to solve this problem is the algorithm optimization algorithm. Taken and is a powerful optimization algorithm.

## 2. Ant Lion Optimization Algorithm (ALO)

The ant lion optimization algorithm (ALO) mimics the ant-hunting mechanism in nature [10, 11]. The five main steps in prey hunting are accidental walking of ants, trapping, trapping ants in the trap, catching prey, and rebuilding the trap. This algorithm can find very competitive results in terms of avoiding local optimality and convergence.

### A) ALO algorithm operators

The ALO algorithm mimics the interaction between ants and ants. To model such interactions, ants need to move in the search space, and the ant lion is allowed to hunt them using traps and become more adaptable. Since ants move randomly while searching for food in nature, a random walking method for modeling ants' movement is selected as follows:

$$x(t) = [0, \text{cumsum}(2r(t1) - 1), \text{dumsum}(2r(t2) - 1), \dots, \text{cumsum}(2r(tn) - 1)] \quad (1)$$

Where *cumsum* calculates the sum of the sums, *n* is the maximum number of repetitions, *t* indicates the random walking step (repetition in this study), and *r(t)* is a random function defined as follows:

$$r(t) = \begin{cases} 1 & \text{if } rand > 0.5 \\ 0 & \text{if } rand \leq 0.5 \end{cases} \quad (2)$$

Which *t* indicates the random walking step (repetition in this method), and *rand* is a random number generated with a uniform distribution in the range [0, 1]. The position of the ants during storage is stored in the following matrix:

$$M_{ant} = \begin{pmatrix} A_{1,1} & A_{1,2} & \dots & \dots & A_{1,d} \\ A_{2,1} & A_{2,2} & \dots & \dots & A_{2,d} \\ \vdots & \vdots & \vdots & \vdots & \vdots \\ A_{n,1} & A_{n,2} & \dots & \dots & A_{n,d} \end{pmatrix} \quad (3)$$

It should be noted that ants are similar to particles in PSO or people in GA. The position of an ant refers to the parameters for a particular answer. The  $M_{Ant}$  matrix is intended to store the position of all ants (variables of all responses) during optimization. To evaluate each ant, a fitness function (target) is used during optimization, and the matrix below stores the fitness function of all ants.

$$M_{OA} = \begin{pmatrix} f(A_{1,1} & A_{1,2} & \dots & \dots & A_{1,d}) \\ f(A_{2,1} & A_{2,2} & \dots & \dots & A_{2,d}) \\ \vdots & \vdots & \vdots & \vdots & \vdots \\ f(A_{n,1} & A_{n,2} & \dots & \dots & A_{n,d}) \end{pmatrix} \quad (4)$$

That  $M_{OA}$  is the matrix of each ant's storage reserve,  $A_{i,j}$  shows the value of the variable *j* (dimension) of the *i*-th mouse, *n* is the number of ants, and *f* is a function of the target. In addition to ants, ants are thought to be hiding in search areas. The following matrix is used to store the position and values of their fit.

$$M_{ant} = \begin{pmatrix} AL_{1,1} & AL_{1,2} & \dots & \dots & AL_{1,d} \\ AL_{2,1} & AL_{2,2} & \dots & \dots & AL_{2,d} \\ \vdots & \vdots & \vdots & \vdots & \vdots \\ AL_{n,1} & AL_{n,2} & \dots & \dots & AL_{n,d} \end{pmatrix} \quad (5)$$

$$M_{ant} = \begin{pmatrix} f(AL_{1,1} & AL_{1,2} & \dots & \dots & AL_{1,d}) \\ f(AL_{2,1} & AL_{2,2} & \dots & \dots & AL_{2,d}) \\ \vdots & \vdots & \vdots & \vdots & \vdots \\ f(AL_{n,1} & AL_{n,2} & \dots & \dots & AL_{n,d}) \end{pmatrix} \quad (6)$$

The  $M_{Antlion}$  matrix stores the value of each valve,  $A_{L_i, j}$  indicates the value of the variable  $j$  (dimension) of the valve  $i$ , the number of valves and the number of variables (dimension).

### B) Hypotheses about the ALO algorithm

Theoretically, for the following reasons, the proposed ALO algorithm can estimate the overall optimization issues [12]:

- Exploration of the search space is guaranteed by the random selection of ants and accidental walking of ants around it.
- The exploitation of the search space is guaranteed by the small, comparative boundaries of the ant's tap traps.
- Due to the use of random walking and the roulette wheel, there is a high probability of solving the escape from the local optimal.
- ALO is a population-based algorithm, so the likelihood of avoiding local optimality is inherently high.
- Ant movement intensity decreases appropriately during each repetition, which ensures the convergence of the ALO algorithm.
- Calculating random walking for each dimension and each ant promotes diversity in the population.
- Changing the position of the ant valve to the position of the best ants during optimization saves promising areas in the search space.
- The best faucet is stored in each iteration and is compared to the best faucet ever obtained (elite).
- The ALO algorithm has very few parameters to adjust.
- The ALO algorithm is a free-sloping algorithm that considers the problem as a black box.

### 3. Apply the ALO optimization algorithm to the problem of determining the optimal location and size of DG

The two independent variables for optimal DG that are considered in this project are DG location and size. Therefore, according to the number of DGs to be placed in the network ( $N_g$ ), the number of independent variables in the problem will be  $2N_g$ . Therefore, it can be said that in applying the valve optimization algorithm to the problem of DG placement and measurement, each solution is a  $1 \times 2N_g$  vector in which the 1 to  $N_g$  valves are the number of buses in which the DGs are to be located. And the  $N_g+1$  to  $2N_g$  drives have the capacity of DGs to be installed at designated buses. For example, if 3 DG units are to be installed in a system, then each solution will be  $X_i = [b_1 \ b_2 \ b_3 \ P_1 \ P_2 \ P_3]$ , which means that in  $b_1$  the DG unit with size  $P_1$  must be installed and it should be noted that in the production of the initial population, the number of buses must be integers and also randomly generated. Also, the DG capacity must be a random

number within the allowable range with a uniform distribution. It should also be noted that the bus number algorithm remains the correct number at all stages of the update. Therefore, the initial population is produced according to the recent points and also considering the constraints of the problem. The constraints set out in this article are described in Figures 7 to 18 [12]. Then, the steps of the algorithm are implemented according to the stated steps with the presented relations.

$$\sum_{n \in N} \sum_{j \in J} \mu_{nj} = N_{DG} \quad \mu_{nj} \in \{0,1\} \quad (7)$$

The  $N_{DG}$  unit has a predetermined capacity.  $\mu_{nj}$  The binary decision variable indicates the allocation of unit  $j$  in bus  $n$ . Lack of identical units in one bus, which should not have two DG units of one technology in one bus.

$$\sum_{n \in N} \mu_{nj} \leq 1 \quad (8)$$

The power balance in the substation is as follows:

$$P_{SE}(t) - P_{Dn}(t) - P_n(t) = 0 \quad \forall n \in N_{n=SE}, \forall t \in T \quad (9)$$

$$Q_{SE}(t) - Q_{Dn}(t) - Q_n(t) = 0 \quad \forall n \in N_{n=SE}, \forall t \in T \quad (10)$$

The  $P_{Dn}$  demand for active power in bus  $n$  in period  $t$ ,  $P_n$  for active power generated in bus  $n$  in period  $t$ ,  $N$  for the number of buses,  $Q_{Dn}$  for reactive power demand in bus  $n$  in period  $t$ ,  $Q_n$  for reactive power generated in bus  $n$  in period  $t$ .

The power balance in different nodes of the substation is as follows:

$$\mu_{nj} P_{DGj}(t) - P_{Dn}(t) - P_n(t) = 0 \quad \forall n \in N_{n \neq SE}, \forall t \in T \quad (11)$$

$$\mu_{nj} Q_{DGj}(t) - Q_{Dn}(t) - Q_n(t) = 0 \quad \forall n \in N_{n \neq SE}, \forall t \in T \quad (12)$$

The limitations of active and reactive power are as follows:

$$P_{SE}^{\min}(t) \leq P_{SE}(t) \leq P_{SE}^{\max}(t) \quad \forall t \in T \quad (13)$$

$$Q_{SE}^{\min}(t) \leq Q_{SE}(t) \leq Q_{SE}^{\max}(t) \quad \forall t \in T \quad (14)$$

DG active and reactive power limit are as follows:

$$P_{DGj}^{\min}(t) \leq P_{DGj}(t) \leq P_{DGj}^{\max}(t) \quad \forall j \in J, \forall t \in T \quad (15)$$

$$Q_{DGj}^{\min}(t) \leq Q_{DGj}(t) \leq Q_{DGj}^{\max}(t) \quad \forall j \in J, \forall t \in T \quad (16)$$

The voltage of the buses is as follows:

$$V_n^{\min}(t) \leq V_n(t) \leq V_n^{\max}(t) \quad \forall n \in N, \forall t \in T \quad (17)$$

Also, the capacity of the lines is as follows:

$$S_{lmm}^{\min}(t) \leq S_{lmm}(t) \leq S_{lmm}^{\max}(t) \quad \forall lmm \in L, \forall t \in T \quad (18)$$

**4. Simulated system information**

To demonstrate the effectiveness of the proposed method, several tests have been performed with two distribution systems, 34 and 85 buses. Figure 1 shows the distribution system of 34-bus. This system is similar to IEEE's 34-bus radial distribution system topology. Line information and bus information are also given in the tables [13]. Figure 2 shows the configuration of the 85-bus system. Line information and bus information are also given in the tables [14].

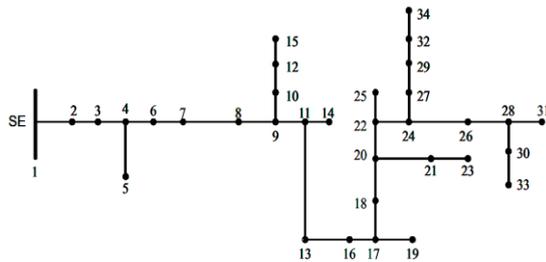


Fig. 1. 34-Bus radial system diagram

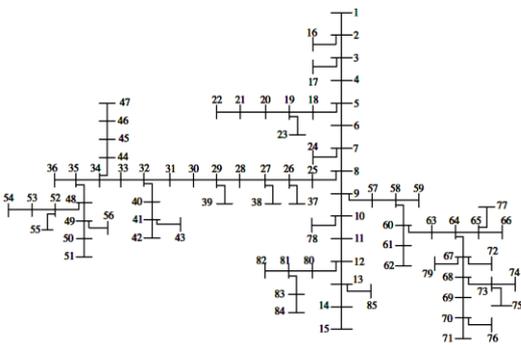


Fig. 2. 85-Bus radial system diagram

**5. Analysis of simulation results**

In Tables 1 to 3, the simulation results for the 34-bus radial system are presented and compared with the results of the paper [12]. A comparison between the total Dis Co payment for the different scenarios obtained by ALO and paper [12] is presented in Table 1. Table 2 shows the total energy loss in percentage. Table 4 presents the simulation results for the 85-bus radial system and compares them with the results of the paper [12]. A comparison between the total DisCo payment and the total energy loss in percentage for the different scenarios obtained by ALO and paper [12] is presented in Table 5.

Table 1 shows that for all three scenarios, the results obtained by the ALO algorithm were better so that for scenario A is 14.25%, for scenario B is 17.28%, and for the scenario, C is 18.55%, profit increases compared to paper [12].

Table.1.  
Simulation results for a 34-bus with 2 DG units

	Algorithm	Buses	Price(€/MWh)	Profit(€)
Scenario	ALO	29, 22	75.3, 71	145254.7
A	GA[12]	29, 32	68.7, 73.2	127135.99
Scenario	ALO	26, 29	81.6, 72.8	250567
B	GA[12]	27, 29	73.6, 78.2	213634.50
Scenario	ALO	28, 29	86.5, 87.8	435663.3
C	GA[12]	24, 29	81.1, 82.9	367482.31

Table.2.  
Simulation results for a 34-bus with 3 DG units

	Algorithm	Buses	Price(€/MWh)	Profit(€)
Scenario	ALO	13, 24, 29	72.3, 71, 73.2	195230
A	GA[12]	29, 27, 23	71.8, 68.7, 71.7	177554.25
Scenario	ALO	29, 26, 22	83.1, 81.7, 72.7	341132.3
B	GA[12]	32,23,24	76.6, 76.4, 79.7	301015.50
Scenario	ALO	29, 23, 26	78.5, 82.3, 84.3	600645.7
C	GA[12]	27, 28,20	79.1, 78.9, 80.6	519933.80

Table 2 shows that for all three scenarios the results obtained by the ALO algorithm were better, so that for scenario A is 9.95%, for scenario B is 13.32% and the scenario, C is 15.52% increase Profit is derived from the paper [12].

Table.3.  
Simulation results for a 34-bus system with 4 DG units

	Algorithm	Buses	Price(€/MWh)	Profit(€)
Scenario	ALO	22, 15,	71, 70.5,	239818
A	GA[12]	4, 18	70.4, 73.3	222066
		29, 18,	71.1, 70.3,	
		30, 28	70.8, 68.6	431904.3
Scenario	ALO	23, 29,	80.5, 79.2,	
B	GA[12]	24, 16	75, 71.4	379969.52
		29, 13,	76.6, 68.8,	
		12, 24	70.8, 72.4	744206
Scenario	ALO	27, 26,	80.7, 81.9,	
C	GA[12]	11, 24	77.8, 78.4	655844.01
		27, 30,	79.1, 78.6,	
		24, 21	78.4, 78.1	

Table 3 shows that for all three scenarios, the results obtained by the ALO algorithm were better, so that for scenario A is 7.99%, for scenario B is 13.66%, and for the scenario, C is 13.47%, profit growth was obtained compared to paper [12].

Table.4.  
Simulation results for 85 bus system with 3 DG units

Algorithm	DG power factor	Buses	Price(€/MWh)	Profit(€)
ALO	0.9 leading	19, 85, 34	66.9, 69.2, 69.8	215417.6
	1	26, 32, 63	67.6, 67.9, 67.9	251150.2
GA[12]	0.9 lagging	32, 2, 60	66.8, 65, 66.8	264481.5
	-	32, 4, 18	65.6, 65.7, 65.6	204900.95

Table 4 shows that when the DG power factor is 0.90 lagging (i.e., DGs, in addition to generating active power, also produce reactive power), the

profit is greater than when working with power factor 1. And when leading works (i.e., DGs use reactive power to generate active power), they make the least profit. The profit generated by ALO was better than GA.

Table 5 shows that for all three power coefficients the results obtained by the GA algorithm were better, so that for the power factor of the unit 2.63%, for the lagging power factor of 3.53% and for the leading power factor So the 1.63% lagging was achieved compared to the ALO algorithm, and the losses for the GA algorithm were better than the ALO algorithm. Although the ALO algorithm was not better than GA, the sum of payments and losses improved compared to when DG was not installed, so that for the unit power factor of 1.70%, for the leading power factor of 1.6% and for the power factor So there was a 1.05% lagging.

Table.5.  
Total DisCo energy losses for different scenarios

	Algorithm	Total payments	Energy losses
WithoutDG	-	4768866.96	7.78
1	ALO	4687416.1532	4.046
	GA[12]	4567283.31	2.33
0.9 leading	ALO	4692628.5437	3.8176
	GA[12]	4540371.00	1.66
0.9 lagging	ALO	4718770.6526	5.4713
	GA[12]	4642861.16	4.02

## 6. Conclusion

DG has many benefits for the distribution system, including reducing losses, reducing peak load, reducing line density, providing ancillary services, improving power quality and reliability, reducing uninterruptible power supply, and delaying costs. Investment in network upgrades noted. Increasing the number of DGs in the network indicates an increase in the cost of installing and maintaining DGs. By determining the optimal number of DGs, it is possible to strike a balance between cost and improve technical parameters in terms of the process of deploying distributed generation resources; therefore, from the company's perspective, it is desirable to install distributed products in areas that bring the most benefits to the network. Give him the most efficiency in the field of network operator activities and responsibilities. In this paper, the problem of locating and optimizing the optimal distribution of scattered products in order to increase profits will be solved provided that the distribution company pays the minimum cost and the method used to solve this problem will be the algorithm optimization algorithm which is

inspired by the behavior of the valve. It is a powerful optimization algorithm. The proposed method for determining the optimal location and size of DG was applied to two systems of radius distribution of 34 and 85 buses. For the 34-bus radius system, three different scenarios with low, medium and high loads have been considered, and for each scenario, the number of DG units was considered in three modes: 2 units, 3 units and 4 units. Comparing the results, it was found that the profit from installing DG and its pricing by ALO algorithm was higher than GA. Also, increasing the number of DGs has always increased profits. As for the total payment of DisCOs and energy losses, it is not possible to say which algorithm performed better. In the 85 bus radial system simulation, one scenario was considered, but three power coefficients for the DGs were considered in three different simulations. In this simulation, it was found that although losses are reduced by DG and the total payment of DisCOs is reduced, but when the power factor is pre-phase and DG produces reactive power in addition to active power, more profit the lowest profit is obtained when the power factor is after the phase. Comparing the two algorithms, GA and ALO, it was found that ALO was more profitable, but GA was less likely to suffer losses and lower overall DisCO payments. However, given the DG owner's solution to this problem, the ALO response is more favorable than the GA response.

## References

- [1]. Zareipour, H., et al, "Distributed Generation: Current Status and Challenges", in proc. 36th Annual North American Power Symposium (NAPS), University of Idaho, August 2004.
- [2]. Griffin, T, et al, "Placement of Dispersed Generations Systems for Reduced Losses", Proceedings of the 33rd Hawaii Conference on System Sciences, 2000.
- [3]. Hadjsaid, H., et al, "Distributed generation Increases the Complexity of Controlling, Protecting, and Maintaining the Distribution Systems", IEEE Computer Application in Power, PP. 23-28, April 1999.
- [4]. Philipson, L., and Willis, H.L., "Understanding Electric Utilities and Deregulation", Marcel Dekker, 1988.
- [5]. Sudipta Ghosh, S.P. Ghoshal and Saradindu Ghosh, "Optimal sizing and placement of distributed generation in a network system", Electrical Power and Energy Systems 32 (2010) 849-856
- [6]. Sneha, J. Adeline, et al. "Optimal Placement of Different Types of Dg Sources in Distribution Networks Using Pso Algorithm and Differential Evolution." (2014).
- [7]. Mohamed, Engy Adel, and Yasser Gamal-Eldin Hegazy. "Optimal Sizing and Placement of Distributed Generators for Profit Maximization Using Firefly Algorithm.", Int'l Conference on Artificial Intelligence, Energy and Manufacturing Engineering (ICAEME'2014), June 9-10, 2014 Kuala Lumpur (Malaysia).
- [8]. Awad, Ahmed SA, Tarek HM El-Fouly, and Magdy MA Salama. "Optimal distributed generation allocation and load shedding for improving distribution system reliability." Electric Power Components and Systems 42.6 (2014): 576-584.
- [9]. Kucuksari, Sadik, et al. "An Integrated GIS, optimization and simulation framework for optimal PV size and location in campus area environments." Applied Energy 113 (2014): 1601-1613.

- [10]. Mirjalili S. The ant lion optimizer. *Advances in Engineering Software*. 2015 May 31; 83: 80-98.
- [11]. Mirjalili S, Jangir P, Saremi S. Multi-objective ant lion optimizer: a multi-objective optimization algorithm for solving engineering problems. *Applied Intelligence*. 2017 Jan 1;46(1):79-95.
- [12]. López-Lezama JM, Contreras J, Padilha-Feltrin A. Location and contract pricing of distributed generation using a genetic algorithm. *International Journal of Electrical Power & Energy Systems*. 2012 Mar 31;36(1):117-26.
- [13]. Kersting WH. Radial distribution test feeders. *IEEE Trans Power Syst* 1991; 6(3):975–85.
- [14]. Das D, Kothari DP, Kalam A. Simple and efficient method for load flow solution of radial distribution networks. *Elect Power Energy Syst* 1995; 17 (5):335–46.